

IN CELEBRATION OF PORTSMOUTH NH 400TH ANNIVERSARY

THE CITY OF PORTSMOUTH DPW WATER DIVISION PRESENTS:

Annual Drinking Water Quality Report



2016



2021



Results from Testing in 2022
Pease Tradeport Water System
PWS ID: 1951020

OUR COMMITMENT: SAFE DRINKING WATER

The City of Portsmouth Water Division is pleased to present the Annual Water Quality Report for Pease. The report summarizes the results of drinking water testing performed from January 1, 2022 through December 31, 2022, and is provided to keep you informed about the quality of the water you rely on every day. It is being sent to every water customer served from the Pease Tradeport Water System (PWS ID# 1951020).

Through 2022, the water from the Pease Tradeport system has continued to meet all water quality standards as regulated by the US Environmental Protection Agency and the NH Department of Environmental Services.

Drinking Water Sources

Our mission is to provide the community with drinking water that meets all current federal and state drinking water standards. The Portsmouth Water Division is constantly monitoring and routinely testing the drinking water according to these requirements to ensure the quality of water delivered to our customers consistently meets these water quality standards. Potential contaminants and impacts from changing weather cause new challenges. We remain vigilant in meeting the goals of water treatment, source water protection, water efficiency, system improvements, fire service capability and community education, while continuing to serve the needs of all our water users. Water Supply Updates are prepared and provided on our webpage at least quarterly, and more often when warranted. Water customers can access these reports at: <https://portsnh.co/WaterSupplyUpdates>

Water supplied to Pease Tradeport Water System customers comes primarily from the groundwater wells located on the Tradeport (Harrison Well, Smith Well, and Haven Well). Portsmouth Water System (EPA PWSID# 1951010) supplies water to the Pease Tradeport Water System as needed. Two percent (2%) of the water supplied to Pease Tradeport was from the Portsmouth Water System in 2022.


Water from the Harrison Well, Smith Well, and Haven Well is pumped to the Grafton Road Drinking Water Treatment Facility (WTF) where it is treated through ion-exchange resin filters, and

granular activated carbon (GAC) filters. This filtration process removes per- and polyfluoroalkyl substances (PFAS) that are present in the Harrison Well, Smith Well, and Haven Well water. Sodium hypochlorite (bleach) for disinfection, fluoride as sodium fluoride (used to prevent tooth decay) and poly/ortho- phosphate (a sequestering chemical to reduce oxidation of iron and manganese, and inhibit corrosion, is used to protect distribution system pipes) are added before entering the distribution system.

When additional supply is needed from the Portsmouth Water System, the water that is pumped from Portsmouth primarily consists of water from three groundwater wells, Portsmouth Well #1, Collins Well, and Greenland Well. Sodium hypochlorite and poly/ortho-phosphate are added to the water supplied by these wells. Fluoride as hydrofluorosilicic acid is also added at the Greenland Well. Occasionally water from the City's sources in Madbury may contribute to the water pumped into Pease from the Portsmouth Water System. The Madbury sources are the Bellamy Reservoir and four wells. The water from the reservoir is treated using a coagulation, dissolved air floatation and dual-media filtration process. The treated water is chlorinated with sodium hypochlorite before distribution into the system. Sodium hydroxide (used to adjust the final pH and alkalinity), fluoride as hydrofluorosilicic acid and poly/ortho-phosphate are also added prior to distribution.



**Pease Supply Sources
Source Percentages in 2022**

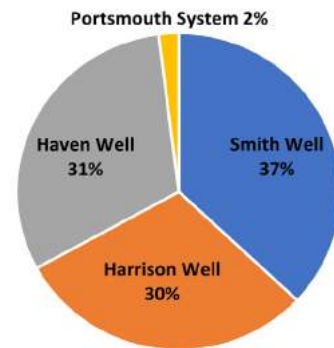

PUBLIC ENGAGEMENT

Safe Water Advisory Group (SWAG)



The Safe Water Advisory Group was created with the approval of City Council on October 5, 2020. Its mission is to review and communicate the latest science on the health and environmental effects of drinking water contaminants (with a heavy focus on PFAS), to monitor federal and state level legislative changes, and to anticipate policy changes that could impact the City of Portsmouth. SWAG met five times in 2021 and discussed topics including PFAS regulations, extent, treatment, and testing programs; legislative items associated with drinking water, private well studies, climate change, and community organizing. The group also toured the Portsmouth Surface Water Treatment Facility in Madbury. Video recordings of SWAG meetings are posted on the City's YouTube channel.

The 2022 Portsmouth City Council voted to reinstate the SWAG for another year. The public is invited to attend meetings and encouraged to be involved with the community and informed of all aspects of the City's water supply.

“Water Has a Memory” Exhibit Partnership with Strawberry Banke Museum

The Planning Department and DPW Water Division collaborated with Strawberry Banke Museum on their “Water Has a Memory” exhibit. It opened during the summer of 2021 to provide the public with information about those who are actively involved with measuring, analyzing, and adapting to the impacts of climate change and sea level rise on the community. The exhibit also incorporates historical timelines and components of the water, wastewater and stormwater systems in the city. This exhibit also invites visitors to “Think Blue” and consider what they can do to spread the word, share stories, and become part of the solution.



Brian Goetz, Deputy Director of Public Works, posing with one of the water system items (an old 1898 cast iron water pipe).

SUSTAINABILITY

New Water Treatment Facility for PFAS Treatment

The new Pease Water Treatment Facility began operations in 2021. The completion of this facility marks the culmination of a seven-year response to the presence of PFAS contaminants that were found in May 2014 to be impacting the three Pease drinking water wells. Past use at the former Pease Air Base of firefighting foam containing PFAS compounds contributed to this contamination. Subsequently, the Air Force agreed to work with the City to treat the drinking water serving the Pease International Tradeport System. The agreement provided the City with funds to reimburse the cost to construct the final treatment system for all three wells, including a dual filtration system consisting of resin and granular activated-carbon filters. The construction of the new Pease Water Treatment Facility followed extensive research, pilot testing and final design for a system to treat the contamination. In partnership with the Air Force, the City conducted a demonstration project starting in September 2016. This project involved the installation of granular activated carbon (GAC) filters for the Harrison and Smith Wells. Subsequently, the City was invited by the firm ECT2 to pilot resin filter technology for the treatment. The success of that pilot led to the use of resin filters in the final facility, which together with granular activated carbon filters (GAC) removes PFAS compounds from the drinking water.

The new treatment processes were started and tested in April 2021 with water from the Harrison Well and Smith Well. After confirming the system was operating as designed, water from the Haven Well was treated through the facility. After confirming that the treated water met standards for drinking water quality and PFAS removal, the treatment began to supply the system. In August 2021, treated water from all three wells entered the system. PFAS samples are collected monthly, and the filtration system is carefully monitored to ensure the media is performing as expected, and media replacement can be appropriately scheduled.



2022 WATER QUALITY RESULTS

CONTAMINANT (UNIT OF MEASUREMENT)		IN COMPLIANCE	VIOLATION (Y/N)	LEVEL MEASURED	RANGE	MCLG	MCL	LIKELY SOURCE OF CONTAMINATION
	Total Coliform Bacteria	✓	N	NO total coliform bacteria detected in the 120 distribution system samples that were collected and analyzed in 2021				Naturally present in the environment
DISINFECTION BYPRODUCTS	Haloacetic Acids (ppb)	✓	N	Highest Level Measured: <1	Non-Detect	N/A	60	Byproduct of drinking water disinfection
	Total Trihalomethanes (ppb) (Bromodichloro-methane, Bromoform, Dibromo-methane, Chloroform)	✓	N	Highest Level Measured: 0.7	0.5 - 0.7	N/A	80	Byproduct of drinking water chlorination
LEAD AND COPPER	Lead (ppb)	✓	N	90th Percentile = 2	0 sites above AL (42 sites sampled)	15	AL = 15	Corrosion of household plumbing systems; erosion of natural deposits
	Copper (ppm)	✓	N	90th Percentile = 0.485	1 site above AL (42 sites sampled)	1.3	AL = 1.3	Corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives
INORGANIC CONTAMINANTS	Barium (ppb) 2019 - 2022 data	✓	N	Highest Level Measured: 9.9 Avg Source Level: 9.7	9.4 - 9.9	2000	2000	Discharge of drilling wastes; discharge from metal refineries; erosion of natural deposits
	Chlorine (ppm)	✓	N	Highest Level Measured: 1.13 Avg System Level: 0.77	0.30 - 1.13	MRDLG = 4	MRDL = 4	Water additive used to control microbes
	Chromium (total) (ppb)	✓	N	Highest Level Measured: <1 Avg Source Level: <1	Non-Detect	100	100	Discharge from steel and pulp mills; erosion of natural deposits
	Fluoride (ppm)	✓	N	Highest Level Measured: 1.02 Avg Source Level: 0.60	0.09 - 1.02	4	4	Erosion of natural deposits; water additive which promotes strong teeth; discharge from fertilizer and aluminum factories
	Nitrate (as Nitrogen) (ppm)	✓	N	Highest Level Measured: 1.2 Avg Source Level: 0.97	0.85 - 1.2	10	10	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits
RADIOACTIVE CONTAMINANTS	Compliance Gross Alpha (pCi/L)	✓	N	Highest Level Measured: 1.1	<1 - 1.1	0	15	Erosion of natural deposits
	Uranium (ug/L)	✓	N	Highest Level Measured: <1	Non-Detect	0	30	Erosion of natural deposits
	Combined Radium 226 + 228 (pCi/L)	✓	N	Highest Level Measured: <1	Non-Detect	0	5	Erosion of natural deposits
UNREGULATED SUBSTANCES	Manganese (ppb) 2019 UCMR data	✓	N	Highest Level Measured: 26	<1 - 26	Naturally-occurring element used in a variety of applications including use in steel production to improve hardness, stiffness and strength. Essential nutrient found in vitamin/mineral supplement and in fortified foods		
PFAS	Per- and Polyfluoroalkyl Substances (PFAS)	✓	N	See PFAS section		Discharge from industrial processes, wastewater treatment, residuals from firefighting foam, runoff / leachate from landfills and septic systems		

DEFINITIONS OF TERMS

- **AL (Action Level)** - Concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.
- **MCL (Maximum Contaminant Level)** - Highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.
- **MCLG (Maximum Contaminant Level Goal)** - Level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.
- **MRDL (Maximum Residual Disinfectant Level)** - Highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
- **MRDLG (Maximum Residual Disinfectant Level Goal)** - Level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
- **N/A (not applicable)** - Sampling was not completed by regulation or was not required.
- **ND (Non-Detect)** - Indicates that the substance was not found by laboratory analysis.
- **ppm (parts per million)** - One part substance per million parts water (or milligrams per liter).
- **ppb (parts per billion)** - One part substance per billion parts water (or micro-grams per liter).
- **ppt (parts per trillion)** - One part substance per trillion parts water (or nanograms per liter).
- **TT (Treatment Technique)** - Required process intended to reduce the level of a contaminant in drinking water.
- **LRAA (Locational Running Annual Average)** - Average of sample analytical results for samples taken at a particular monitoring location during the previous four calendar quarters. Amount Detected values for TTHMs and HAAs are reported as LRAAs.

2022 WATER QUALITY RESULTS

Per- and Polyfluoroalkyl Substances (PFAS)

On September 30, 2019 the NHDES established limits on the concentrations of four per- and polyfluoroalkyl substances (PFAS) in drinking water. The NHDES maximum contaminant level (MCL) for drinking water and groundwater is 15 parts per trillion (ppt) for perfluorooctane-sulfonic acid (PFOS), 12 ppt for perfluorooctanoic acid (PFOA), 11 ppt for Perfluorononanoic Acid (PFNA), and 18 ppt for Perfluorohexane sulfonic acid (PFHxS). These limits are based on an annual rolling average of the sample results. In March, 2023, the US EPA proposed regulations that would limit acceptable concentrations of six PFAS in drinking water, including the four PFAS currently regulated by the NHDES. The proposed regulation is currently open for public comment.

The US EPA's finalized regulation is expected in late 2023 or early 2024. Until the EPA finalizes the PFAS drinking water regulation, water suppliers in NH are required to meet the NHDES PFAS limits. Over the past nine years, the Harrison Well and Smith Well in the Pease Tradeport Water System, and Portsmouth Well #1 and Collins Well in the Portsmouth Water System, have been routinely monitored for PFAS by the Air Force. Since the activation of the Haven Well, it has been sampled monthly. The City of Portsmouth samples all of the Portsmouth water supply sources quarterly. Sample results from 2022 are summarized in the PFAS table in this report. All monitoring data is available online: cityofportsmouth.com/publicworks/water/pease-tradeport-water-system

PER- AND POLYFLUOROALKYL SUBSTANCE (concentrations* reported in ng/L or ppt)		NHDES MAXIMUM CONTAMINANT LEVEL (MCL)	PORTSMOUTH WATER SUPPLIED TO PEASE SYSTEM			PEASE TRADEPORT TREATED WELL WATER
			PORTSMOUTH WELL #1	COLLINS WELL	GREENLAND WELL	SUPPLIED AFTER GAC TREATMENT
# of samples in 2022			13	13	4	13
% of water supplied in 2022			0.7%	0.3%	1.2%	97.8%
6:2 Fluorotelomer Sulfonate (6:2 FTS)	not regulated	Average	BD	ND	ND	ND
		Range	ND - 1	ND	ND	ND
Perfluorobutane-sulfonic acid (PFBS)	not regulated	Average	3	12	2	ND
		Range	2 - 3	5 - 20	ND - 3	ND
Perfluorobutanoic acid (PFBA)	not regulated	Average	4	4	2	16
		Range	2 - 5	2 - 10	ND - 3	4 - 30
Perfluoroheptanoic acid (PFHpA)	not regulated	Average	4	BD	1	ND
		Range	2 - 6	ND - 2	ND - 3	ND
Perfluorohexane-sulfonic acid (PFHxS)	18	Average	7	2	1	ND
		Range	5 - 10	ND - 3	ND - 3	ND
Perfluorohexanoic acid (PFHxA)	not regulated	Average	6	1	4	ND
		Range	4 - 9	ND - 3	4 - 5	ND
Perfluorononanoic acid (PFNA)	11	Average	BD	BD	ND	ND
		Range	ND- <1	ND- <1	ND	ND
Perfluorooctane-sulfonic acid (PFOS)	15	Average	5	3	4	ND
		Range	3 - 6	ND - 6	3 - 5	ND
Perfluorooctanoic acid (PFOA)	12	Average	5	3	4	ND
		Range	3 - 8	ND - 6	4 - 5	ND
Perfluoropentanoic acid (PFPeA)	not regulated	Average	7	2	5	ND
		Range	4 - 11	ND - 4	3 - 6	ND

TABLE ABBREVIATIONS & NOTES:
Due to laboratory analytical method limitations, low concentrations reported for these chemicals are considered estimates unless the amount measured is above 2 ng/L (ppt).
Averages are calculated using zero for samples that were less than detection, per NHDES guidance.
ND (none detected): Indicates that the substance was not found by laboratory analysis.
BD (below detected level): Average calculated resulted in value below the detection limit.
PFAS analyzed but not detected in the samples: 8:2 Fluorotelomer sulfonate (8:2 FTS); Perfluorohexanesulfonic acid (4:2 FTS); Perfluorodecanoic acid (PFDA); Perfluorododecanoic acid (PFDoA); Perfluoroheptanesulfonic acid (PFHpS); Perfluoroundecanoic acid (PFUnA); Perfluoro-3-Methoxypropanoic Acid (PFMPA); Perfluoro-4-Methoxybutanoic Acid (PFMBA); Perfluoro(2-Ethoxyethane)Sulfonic Acid (PFEEA); Nonfluoro-3,6-Dioxaheptanoic Acid (NFDHA); Perfluoropentanesulfonic acid (PFPeS); 2,3,3,3-Tetrafluoro-2-(1,1,2,2,3,3,3-Heptafluoropropoxy)-Propanoic Acid (HFPO-DA); 4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA); 9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9Cl-PF3ONS); and 11-Chloroicosafuoro-3-Oxaundecane-1-Sulfonic Acid (11Cl-PF3OUs)

For more information about PFAS health effects: www.atsdr.cdc.gov/sites/pease/index.html

Source Water Assessment

Portsmouth Water Division routinely updates inventories of potential contaminant threats and is actively pursuing opportunities to increase the protection of our groundwater supplies and the Bellamy Reservoir through property and easement acquisitions. NHDES prepared drinking water source assessment reports for all public water systems between 2000 and 2003 in an effort to assess the vulnerability of each of the State's public water supply sources. Included in the report is a map of each source water protection area, a list of potential and known contamination sources and a summary of available protection options. The results of the assessment have been updated and are provided in the table above. Risk factors, such as proximity of highways and proximity of known contamination, are ranked and summarized in the summary of susceptibility ratings section in terms of the number of factors per risk category. The complete assessment report is available for review at the DPW office and online: <https://www.des.nh.gov/water>

SOURCE WATER ASSESSMENT RESULTS	SYSTEM	SOURCE INFORMATION	SUMMARY OF SUSCEPTIBILITY RATINGS		
			HIGH	MEDIUM	LOW
PORTSMOUTH		Greenland Well - GPW 003	2	3	7
		Portsmouth Well - GPW 004	5	2	5
		Collins Well - GPW 010	3	2	7
PEASE		Smith Well - GPW 001	4	2	6
		Harrison Well - GPW 009	4	1	7
		Haven Well - GPW 002	5	0	7

WHAT'S IN YOUR DRINKING WATER AND WHAT'S NOT

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons (e.g., persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants) can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. The US EPA/Centers for Disease Control and Prevention (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline at 800-426-4791.

Lead and Copper

Portsmouth Water Division takes the responsibility of protecting your health very seriously. We want you to make informed decisions about your drinking water. Lead is not present in the water when it leaves our treatment and well facilities, or in the water mains that run below the streets. However, lead can be present in old service line connections that tie homes to the water system or plumbing inside homes and businesses. Due to the age of many houses in Portsmouth and surrounding towns, and the associated potential for leaded plumbing components, we encourage customers to have their water tested by a certified laboratory, especially if there are children under six or pregnant women in the household. We actively adjust the water chemistry at the treatment facility and well facilities according to our Corrosion Control Program, to reduce the potential for lead in households to dissolve into the water and end up at the tap. But if lead is present in your plumbing system, and is in contact with water, some risk remains. Information about our Corrosion Control Program can be found on the City's website.

Lead was a common material used in plumbing until the late 1980s. It is a powerful toxin that is harmful to human health. Elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Pregnant women, infants and young children are especially vulnerable because even low levels of lead in the blood of children can result in behavior and learning problems, lower IQ and hyperactivity, slowed growth, hearing problems and anemia. Adults who drink water with lead concentrations over 15 parts per billion (ppb) for many years could develop kidney problems or high blood pressure.

Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We are responsible for providing high-quality drinking water but cannot control the variety of materials used in private plumbing components.


When your water has been sitting for several hours, you can minimize the potential for lead exposure by running the tap for 30 seconds to two minutes before using water for drinking or cooking. Do not use hot water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods and steps

you can take to minimize exposure is available from the Safe Drinking Water Hotline at 800-426-4791. Additional information is available from NHDES by calling 603-271-2516 or online: <https://www.des.nh.gov/water/drinking-water/lead>. A list of laboratories that can test your water for lead is available on the City's website: <https://www.cityofportsmouth.com/publicworks/water/information>

Old galvanized service lines are still in service at some locations in Portsmouth and Newington, even though their service life is typically only between 20 and 40 years. This type of pipe, besides being at high risk of failing and causing water quality issues, has the potential to contain lead as a result of their typical connection with the water main. Lead pipe, referred to as "jumpers" or "goosenecks" were historically used to make these connections to galvanized service lines. If you have a galvanized service line, the Water Division strongly advises that they be replaced with copper as soon as possible. Please contact the Department of Public Works if you plan to have your service line replaced.

Typically, at least 20 samples are taken every year from the Pease Tradeport System. In response to the activation of the new water treatment facility, 40 samples were taken between July 1 and December 31, 2021, and an additional 40 samples were taken between January 1 and June 30, 2022. The 2022 lead and copper testing resulted in all of the 42 sites sampled having less than the EPA Action Limit for lead. Of the 42 samples, 37 did not have any lead detected, and five had lead measured at levels less than 3 ppb. For more information on this topic, please visit the City's website.

Fluoridation

Your public water supply is fluoridated. According to the CDC,  if your child under the age of six months is exclusively consuming infant formula reconstituted with fluoridated water, there may be an increased chance of dental fluorosis.

Consult your child's health care provider for more information. Dental fluorosis, in moderate or severe forms, may result in brown staining and/or pitting of the permanent teeth before they erupt from the gums. Concerns for dental fluorosis arise when fluoride levels are greater than 2 mg/L.



WATER QUALITY MONITORING

POSSIBLE CONTAMINANTS IN DRINKING WATER SOURCES

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over land or through the ground, it dissolves naturally occurring minerals, and in some cases, radioactive material. It can pick up substances resulting from the presence of animals or human activity. Such substances are called contaminants, and may be present in source water as:

Microbial contaminants, such as viruses and bacteria, which may come from wastewater treatment plants, septic systems, agricultural livestock operations, or wildlife;

Inorganic contaminants, such as salts and metals, which can be naturally occurring or may result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming;

Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses;

Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production and may also come from gas stations, urban stormwater runoff, and septic systems;

Radioactive contaminants, which can be naturally occurring or may be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the EPA prescribes regulations limiting the amount of certain contaminants in water provided by public water systems. The FDA regulations establish limits for contaminants in bottled water, which must provide the same protection for public health. Drinking water, including bottled water, may contain small amounts of some contaminants. The presence of these contaminants does not necessarily indicate that the water poses a health risk. For more information about contaminants and potential health effects the EPA's Safe Drinking Water Hotline at 800-426-4791.

During the past year, we have taken hundreds of water samples to monitor and test for the presence of radioactive, biological, inorganic, volatile organic and synthetic organic contaminants. The tables presented show only those contaminants that were detected in the water. Many more elements were tested for, but not detected. They are not included in this report. The state requires us to monitor for certain substances less than once per year because the concentrations of these substances do not change frequently. In these cases, the most recent sample data are included, along with the year when the sample was taken.

Portsmouth has completed the fourth stage of the EPA's Unregulated Contaminant Monitoring Rule (UCMR4) program that started in 2018. The UCMR program benefits the environment and public health by providing the EPA with data on the occurrence of contaminants suspected to be in drinking water. This helps the EPA determine if it needs to introduce new regulatory standards to improve drinking water quality. Chemicals analyzed for UCMR 4 included ten cyanotoxins, two metals, eight pesticides, one pesticide manufacturing byproduct, three brominated haloacetic acids, three alcohols, and other semi-volatile chemicals. The results of these tests are summarized in this report. *Chemicals that were not detected are not included.*

Water Quality Parameters

Water quality parameters are routinely monitored to assess the general characteristics of the water supply. Note that the range of some of these parameters illustrates the differences between the characteristics of the surface water supply and the groundwater supply.

PARAMETERS (UNITS)	AVERAGE LEVEL	RESULTS RANGE	SECONDARY DRINKING WATER STANDARD SMCL
Chloride (ppm)	58	35 - 83	250
Copper (ppb)	24	<2 - 66	1300
Iron (ppb)	17	<10 - 30	300
Manganese (ppb)	13	4 - 24	50
pH	7.6	7.5 - 7.7	6.5 - 8.5
Sulfate (ppm)	15	<1 - 15	250
Conductivity (umhos/com)	475	434 - 499	N/A
Alkalinity (ppm)	121	118 - 125	N/A
Hardness (ppm as CaCO3)	121	115 - 127	N/A
Ortho-Phosphate (ppm)	0.99	0.85 - 1.16	N/A
Sodium (ppm)	31	30 - 31	N/A
Zinc (ppb)	3.4	2.9 - 3.9	5000





CITY OF PORTSMOUTH
DEPARTMENT OF PUBLIC WORKS
680 PEVERLY HILL ROAD
PORTSMOUTH, NH 03801

Important Contact Information

City of Portsmouth
Department of Public Works
Water Division
680 Peverly Hill Road
Portsmouth NH 03801
(603) 427-1530
cityofportsmouth.com/publicworks/water

WATER QUALITY QUESTIONS:

Albert Pratt, P.E.
Water Supply Operations Manager
anpratt@cityofportsmouth.com
(603) 520-0622

Mason Caceres
Water Quality Specialist II
mecaceres@cityofportsmouth.com
(603) 312-3804

BILLING QUESTIONS:

(603) 610-7248 or (603) 610-7237
billpay@cityofportsmouth.com
To pay utility bills online
cityofportsmouth.com/city/pay-my-bill

FEDERAL & STATE AGENCIES:

EPA Safe Drinking Water (800) 426-4791
epa.gov/environmental-topics/water-topics
NH Department of Environmental Services
(603) 271-3503 des.nh.gov/water

Get involved! It's your drinking water and your input is important to us.

Participate in a City Council meeting. Meeting agendas are posted on the City's website and posted in the lobby of City Hall at 1 Junkins Avenue. Portsmouth's Government TV Channel is located on Comcast Channel 22 and in HD on Comcast Channel 1072. Meetings are broadcast live and rebroadcast. Municipal meetings are also live streamed in HD on the City's YouTube channel.



PRODUCTION FROM
PEASE WELLS



640,414 gallons/avg day

WATER DEMAND



654,565 gallons/avg day

